


Understanding grease removal and the 25% rule



Per City Ordinance, all food service establishments must have grease removal devices maintained by a certified grease hauler when they reach 25% of the design capacity OR a minimum of quarterly. Please contact your service provider or the WRF with any questions.

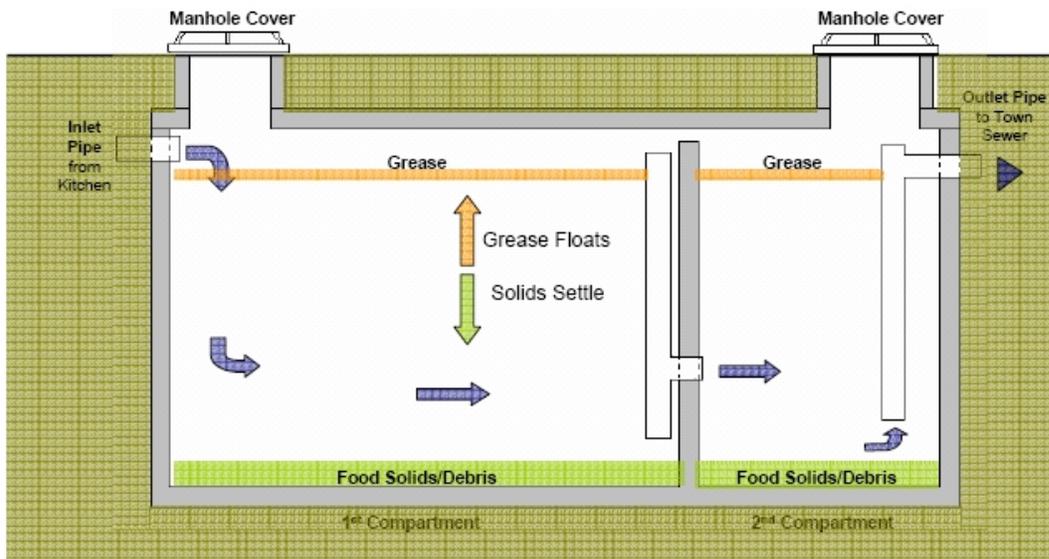

4.0'
3.5'

FOG that floats to the top of the grease removal device (0.5 ft.)

$$= \quad =$$

$$= \quad = 37.5\%$$

Dirty, gray wastewater

1.0'

Solids that fall to the bottom of the grease removal device (1.0 ft.)

0'

KNOXVILLE WATER RECLAMATION
 305 S THIRD ST.
 KNOXVILLE, IA 50138
 641-828-0587
 wrf@knoxvilleia.gov